

7 March 2025

# Gwydir Regulated River Water Source

## Water allocation update

There is no allocation increment to General Security (GS) licences in the Gwydir Regulated River Water Source this time. The GS account balance is about 340 gigalitres (GL), or an average 67% of entitlement. The Environmental Water Allowance (EWA) account balance is about 84 GL or an average 188% of entitlement.

Inflows since the last assessment have not been enough to increase GS allocations. This resource assessment is based on information to 28 February 2025. Any changes in resources from this date forward will be captured in the next resource assessment.

## Current allocation and EWA credit

7 March 2025	Allocation Increment	Average Account Balance
General Security	0%	67%
EWA	0%	188%

## Storage volume (as of 7 March 2025)

- Copeton Dam is about 51% full – holding about 704 GL.


## Key information

- In February, inflows to Copeton Dam were 2.1 GL, and downstream tributary inflows added about another 4.1 GL to the system.
- During February, total essential supply demand was about 12.6 GL, and GS usage was approximately 36 GL. Around 2.5 GL of EWA delivered during this period.

## Climate and streamflow outlooks

The latest Bureau of Meteorology (BoM) monthly outlook for April 2025 indicates that rainfall is likely to be around median to above median across the catchment. Daytime and overnight temperatures are expected to be above median over this period. For further details: [Overview – Summary - Climate Outlooks](#)

The Bureau of Meteorology issues a seasonal flow forecast for the Gwydir River at Yarrowyck, upstream of Copeton Dam (see the figure below). This may provide an indication of potential inflows into the dam in the coming months. Most of the forecast quantiles are lower than the historical flows from February to April 2025 indicating a dryer quarter. The graph for February to April 2025 is shown below, and updates can be found at: [Seasonal Streamflow Forecasts: Water Information: Bureau of Meteorology \(bom.gov.au\)](#)

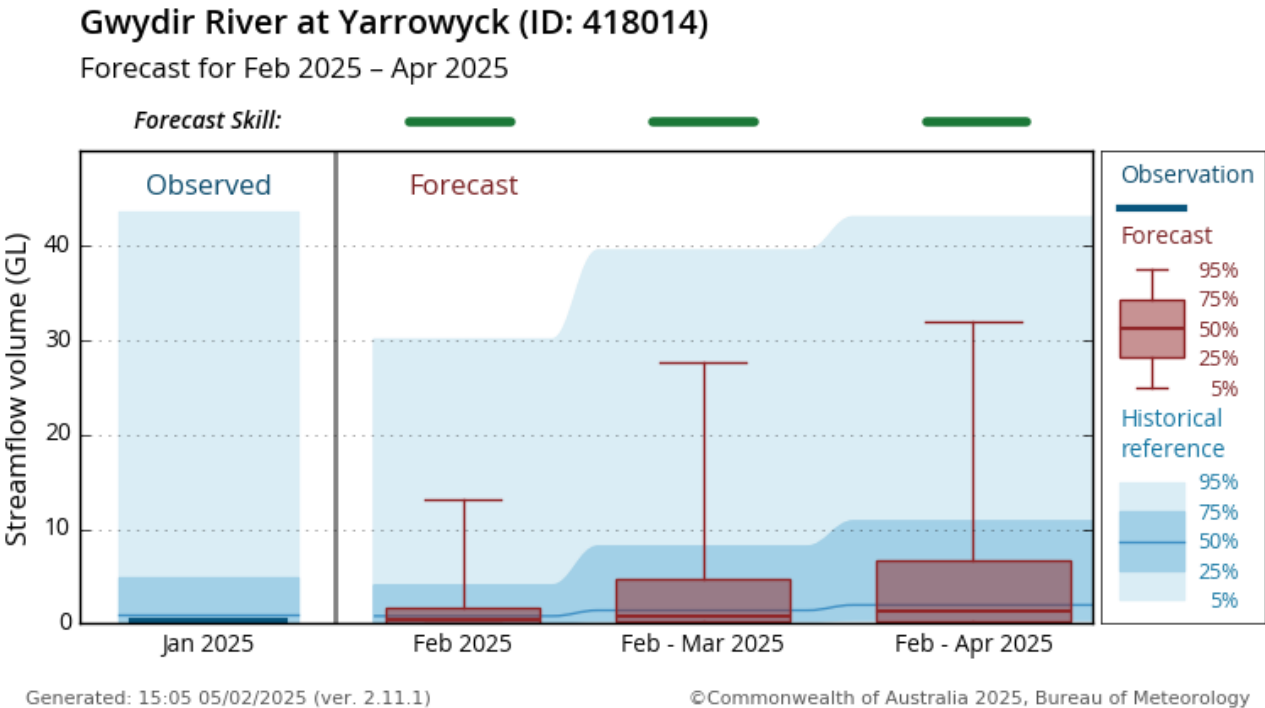

Resource assessment data sheet


Resource distribution (as of 28 February 2025)		Volume (GL)
Copeton Dam active volume		693.5
less		
Environmental Water Allowance		84.4
Essential Supplies <sup>(1)</sup>		79.8
General Security Irrigator Account Balance		199.1
General Security Held Environmental Water Account Balance <sup>(2)</sup>		140.7
Delivery Loss General Security <sup>(3)</sup>		101.9
Delivery Loss EWA <sup>(3)</sup>		25.3
Storage Evaporation Losses <sup>(4)</sup>		62.3
equals		
Surplus (or Deficit) <sup>(5)</sup>		0.0

**Notes:**

- (1) This is a reserve to provide for local water utility, stock and domestic, high security and riverine environments for the next 24 months. It also includes stock and domestic replenishments, associated delivery loss, and end-of-system flow requirements. This is offset by the minimum inflow into Copeton recorded over February 1918 to January 1920. *The full reserve is 82.9 GL. The current balance is 79.8 GL and will be topped up first from the next inflows.*
- (2) General security held environmental water (HEW) account balance. These entitlements are held and/or managed either singly or jointly by various environmental holder groups, including the NSW Environment Water Holder and the Commonwealth Environmental Water Holder (CEWH).
- (3) This volume reflects the water needed to deliver general security and EWA water. Traditionally, a 30% delivery loss has been budgeted for this river system. See the table below on this statement for the actual volume remaining in the budget, which may be lower.
- (4) Storage evaporation loss is based on projected storage depletion over the next 24 months and experiencing high evaporation of February 1918 to January 1920.
- (5) Surplus (or deficit) of water available after accounting for all commitments. There is no surplus or deficit this time.

### Resource Distribution as at 28 February 2025

#### Gwydir Regulated River Water Source

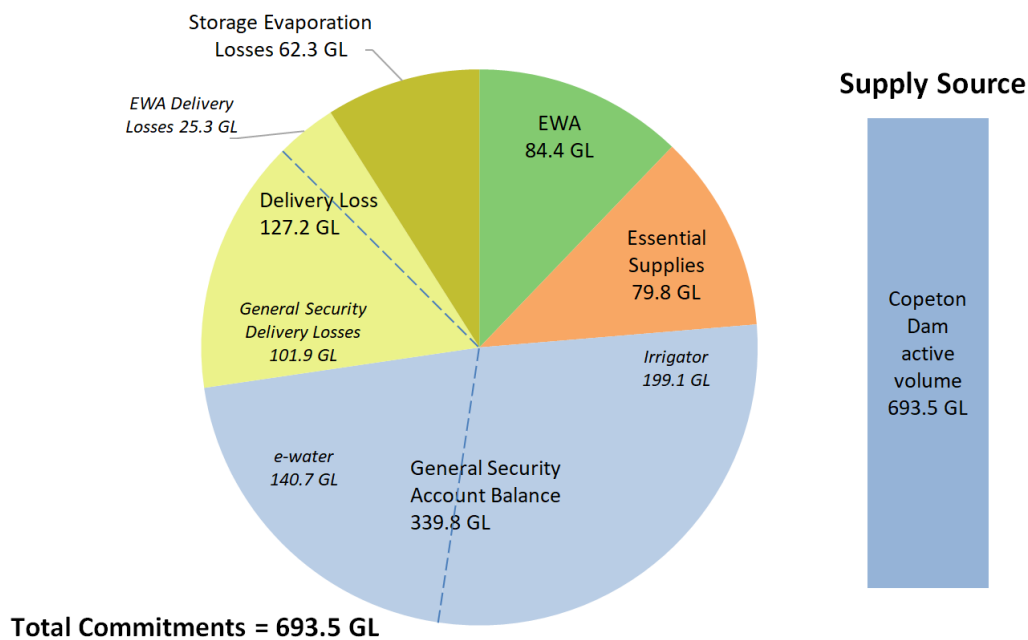

## Resource assessment as of 28 February 2025

Volumes in GL	Budget	Current	Additional	Balance
Storage Evaporation Loss	62.3	65.6	-3.3	62.3
Essential Supplies for next 24 months	82.9	68.8	10.9	79.8
Delivery Loss EWA+GS (256 GL max)	127.3	134.4	-7.1	127.3
<i>Delivery Loss GS (229.0 GL max)</i>	<i>101.9</i>	<i>108.6</i>	<i>-6.6</i>	<i>101.9</i>
<i>Delivery Loss EWA (27 GL max)</i>	<i>25.3</i>	<i>25.8</i>	<i>-0.5</i>	<i>25.3</i>
EWA (90 GL max)		84.4	0.0	84.4
General Security (764.5 GL max)		339.8	0.0	339.8
Uncommitted resources		0.5	-0.5	0.0
<b>Total</b>		<b>693.5</b>	<b>0.0</b>	<b>693.5</b>

General Security	Value	Unit
Incremental Increase CREDITED	0.00	GL
Available Water Determination	0.00	ML/unit share

## Water allocation and EWA credits in 2024/25

Date	Category	Increment	Total 2024/25	Account Balance
1-Jul	LWU, Domestic & Stock	100%*	100%*	100%*
1-Jul	High Security	1.00 ML/unit share*	1.00 ML/share*	100%*
1-Jul	Supplementary	1.00 ML/unit share*	1.00 ML/unit share*	100%*
1-Jul	Floodplain harvesting	1.00 ML/unit share*	1.00 ML/unit share*	100%*
5-Jul	General Security	0.01 ML/unit share	0.01 ML/unit share	92%
5-Jul	EWA	1%	1%	199%
7-Aug	General Security	0.09 ML/unit share	0.10 ML/unit share	100%
7-Aug	EWA	9%	10%	200%*
6-Sep	General Security	0.11 ML/unit share	0.21 ML/unit share	108%
6-Sep	EWA	11%	21%	200%*
8-Oct	General Security	0.03 ML/unit share	0.24 ML/unit share	110%
8-Oct	EWA	3%	24%	186%
7-Nov	General Security	0.03 ML/unit share	0.27 ML/unit share	106%
7-Nov	EWA	3%	27%	188%
6-Dec	General Security	0.01 ML/unit share	0.28 ML/unit share	101%

Date	Category	Increment	Total 2024/25	Account Balance
6-Dec	EWA	1%	28%	189%
9-Jan	General Security	0.03 ML/unit share	0.31 ML/unit share	91%
9-Jan	EWA	3%	31%	192%
7-Feb	General Security	0.01 ML/unit share	0.32 ML/unit share	74%
7-Feb	EWA	1%	32%	193%

\* Maximum allowable.

## Storage volume simulation

Storage outlook for the assessment horizon is provided below. It shows that with current commitments and an assumed repeat of historical minimum inflows or median inflows together with forecast demands, the volume in Copeton Dam will reduce to a minimum by the end of January 2027 then begin to recover by February 2027.

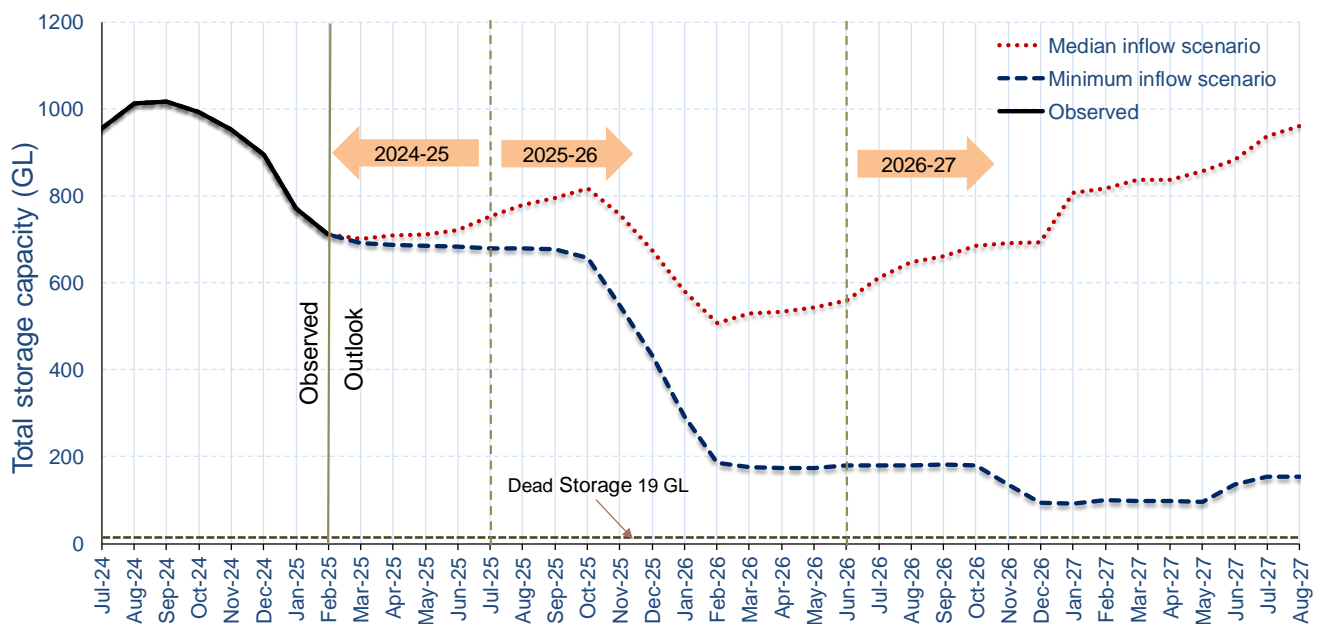


Figure: Simulated of Copeton Dam storage volume

---

## Water allocation guide

The NSW Department of Climate Change, Energy, the Environment and Water produced a series of guides to describe the water allocation methods for most NSW regulated river systems. The guide for this water source is available at the following link: [Resource assessment process | NSW Government Water](#)

---

## Further information

The next routine monthly water allocation statement for this water source will be published on **Monday 7 April 2025**.

*Information on available water determinations and water sharing plans is available on the department's website: [NSW Government Water](#).*

*Subscribe [here](#) to receive the Department of Climate Change, Energy, the Environment and Water's monthly email update on water planning, management and reform in New South Wales.*

*You can also follow the Department on X: [@NSWDCCEEW\\_Water](#)*

*Feedback on this work or any aspect of the Department's service can be provided by the widget on the right at [Department of Climate Change, Energy, the Environment and Water | NSW Government](#).*