


Wyangala Dam Wall Raising

New water treatment plant at Wyangala

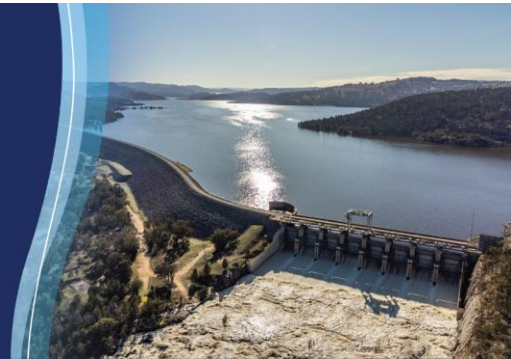

Noisy work: site preparation for construction of a new water treatment plant at Wyangala

The NSW Government is funding a new \$5 million water treatment plant at Wyangala as early works for the proposed Wyangala Dam Wall Raising Project.

Enviropacific Services has been engaged to design, build and commission the new plant which will provide clean drinking water to Wyangala and Wyangala Waters Holiday Park.

A development application for the water treatment plant was approved in December 2021 and the team started site establishment in February 2022.

Upcoming work

In preparation for construction the site team need to remove some vegetation and large rocks to provide safe access and level the site. This work will include upgrading access between the existing water treatment plant and the new plant. To carry out this work, the team will be doing noisy work including using rock breakers, dump trucks, chainsaws, jackhammers, and concrete saws.

When will this work be carried out?

Rock breaking will be carried out from **Thursday 9 March 2022** for **two weeks**, weather permitting. The noisy work will be carried out within standard construction hours from **8am to 6pm** between **Mondays and Fridays** and from **8am to 1pm** on **Saturdays**.

How noisy will it be?

Rock breaking will be the noisiest activity during the site preparation work. Rock breaking will create noise levels up to 65 dB generally for surrounding community. This is more than conversation speech but less than a busy street. Other activities will create less noise. We have provided a diagram to help explain noise levels.



Noise level comparisons sourced from Transport for NSW's Construction Noise and Vibration Strategy

Wyangala Dam Wall Raising

New water treatment plant at Wyangala




How we will manage noise

Rock breaking activities will be intermittent and kept to a minimum. Noise mitigation measures will be used where possible, but residents are still likely to still hear some noise, particularly from the rock breaking. Measures to reduce this noise include noise respite periods, maximising the distance between noisy equipment and residential areas and monitoring noise to ensure it does not exceed stated levels.

Contact us

If you have any questions or concerns about this work please contact our Project's Community and Stakeholder Engagement Team on 1800 735 822 or email wyangaladamproject@dpie.nsw.gov.au

Thank you for your patience during this important work.

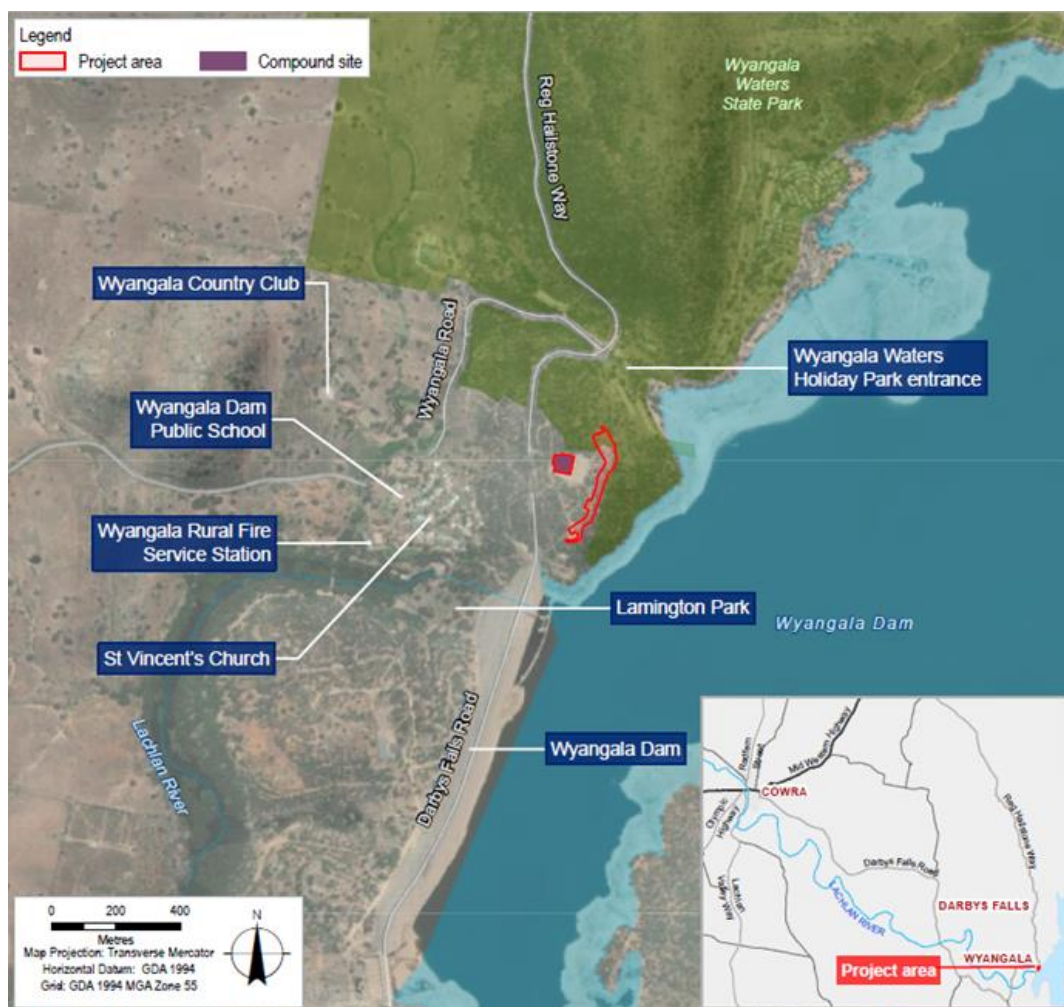

Location of the project area for the new water treatment plant at Wyangala